


The TAC 2222 offers combined heating and domestic hot water control for hot water heating systems. The radiator circuit is controlled according to an outdoor temperature-compensated reset curve and reference sensor. The domestic hot water is controlled by using a separate constant temperature controller.

This is what you get:

- Automatic adjustment of the reset curve
- Ramp limitation of supply setpoint
- Control of room temperature via reference sensor
- Weekly program for night setback
- Separate weekly program for domestic hot water and external unit
- Holiday program for heating and domestic hot water
- Variable night setback and morning heating
- Optimised changeover from daytime operation to night setback
- Separate limitation of return temperature of heating and domestic hot water
- Pump control with exercise function
- Heat control using an external unit (SPC control)
- Extended daytime operation and forced night setback from an external unit
- Domestic hot water control
- Alarm

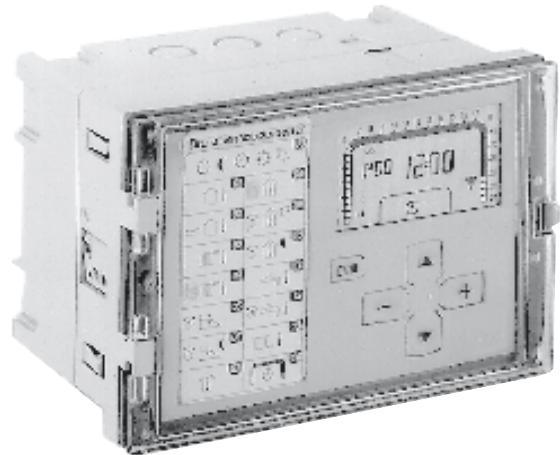

Simple symbols, a clear LCD display and a minimum of buttons make it easy to read and change the values.

There are three adjustable curve points where you can adjust the reset curve exactly to suit different heating systems. A reference sensor is used to adjust the reset curve and the duration and the night setback automatically. Adjustments resulting from seasonal variations are automatic.

There is an additional weekly program that gives you the option of having separate setpoints for daytime and night-time domestic hot water. You can also use this timer channel to control any other item of equipment.

The timer automatically adjusts the clock in the controller to compensate for daylight saving time and leap years.

TECHNICAL DATA

Part number TAC 2222:

Controller 200-2052-000

Manual 0-004-6905

Power supply 24 V AC $\pm 20\%$, 50-60 Hz

Power consumption 3W

Thermistor inputs:

Type of thermistor 1800 ohm/25 °C

Measurement range -50 °C to +120 °C

Relay outputs:

Max. voltage 250 V AC

Max. current 2 A

Inputs:

Sensor inputs B1-B4, U1, U4 thermistor input (see above)

Heat adjustment (SPC), U2 0-10 V DC

Pump alarm, U3 closing contact to M

Extended daytime operation, X1 closing contact to M

Forced night setback, X2 closing contact to M

Outputs:

Circulation pump, K1 relay output (see above)

Start time optimisation, K2 relay output (see above)

Buzzer alarm, K3 relay output (see above)

Weekly program 2, K4 relay output (see above)

Open heating valve, K5 relay output (see above)

Close heating valve, K6 relay output (see above)

Domestic hot water valve, Y1 ... 0-10 V DC or 2-10 V DC

Additional connection to outdoor temp., Y2 0-10 V DC

Calendar clock:

Accuracy ± 12 minutes/year at +25 °C

Reserve running time 48 hours

Enclosure rating IP 40, front IP 54

Ambient temperature:

Operating 0 °C to +50 °C

Storage -20 °C to +50 °C

Ambient humidity max. 90% RH

Electromagnetic compatibility:

Emission EN 50081-1




Immunity EN 50082-1

Material ABS plastic

Colour grey/red/transparent

Weight 0,7 kg

Overall dimensions WxHxD (mm) 144x96x96



Dimensions in mm

EXAMPLE OF CONTROLS

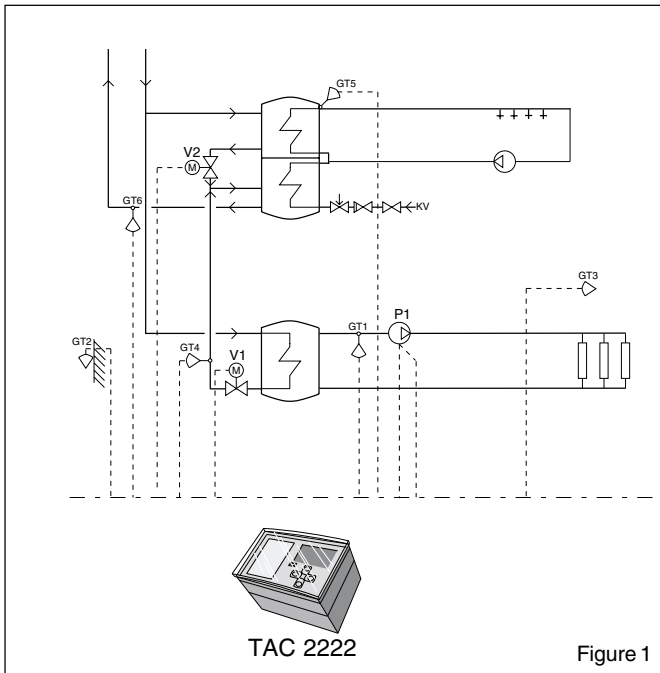


Figure 1

District heating system

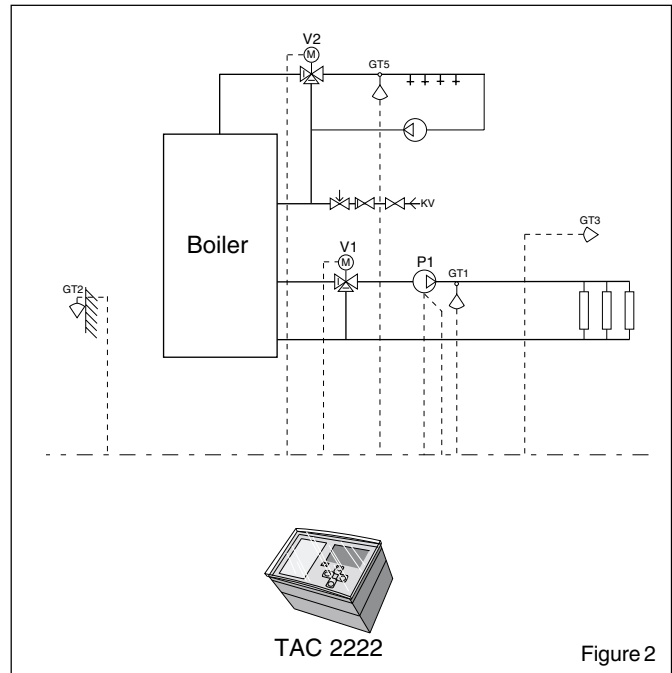


Figure 2

Shunt control with boiler

SUPPLY CONTROL

Reset curve

The reset curve for the supply temperature is based on three dimension points. The outer points are determined fixed to the outdoor temperature, whereas the breakpoint in the middle of the curve can be adjusted: see Figure 3.

The reset curve can be shifted in parallel in systems without a reference sensor. A further parallel shift can be made for night setback. In systems with reference sensors, the curve can be adjusted automatically depending on the room temperature.

The supply temperature can be limited to a minimum and maximum.

Automatic adjustment of the reset curve

The reset curve for the supply temperature can be adjusted automatically via the reference sensor. The reset curve is corrected continuously so that it is adapted exactly to suit the relevant building after a time.

In systems without reference sensors, or if automatic curve adjustment has been switched off, it is possible to design a specific reset curve by manually setting the curve points.

Damped outdoor temperature

The purpose of the supply temperature control is to maintain the correct room temperature irrespective of changes in the outdoor temperature.

The thermal inertia and mass of the building shell mean that a rapid change in outdoor temperature takes a while to affect the room temperature. To make effective use of the heat storage capacity of the building shell, regulation takes place according to a damped outdoor temperature: see Figure 4.

The amount of damping is adjustable to suit all types of buildings.

This function prevents a cold effect when the outdoor temperature rises quickly, and unnecessary additional heating during the usually cool evening hours before night setback.

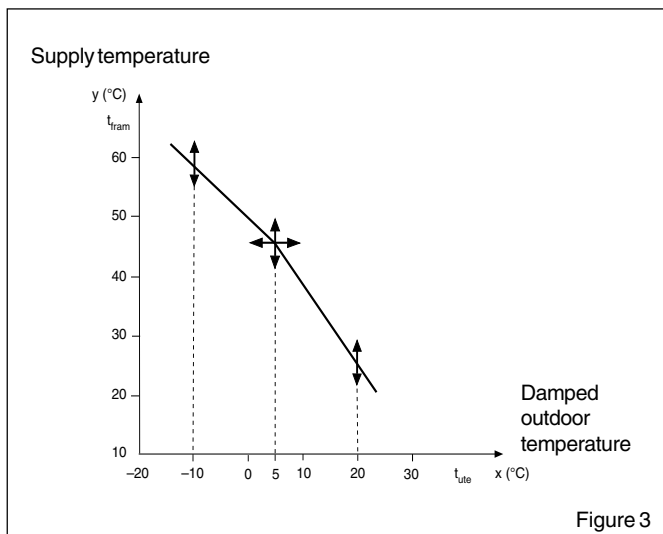


Figure 3

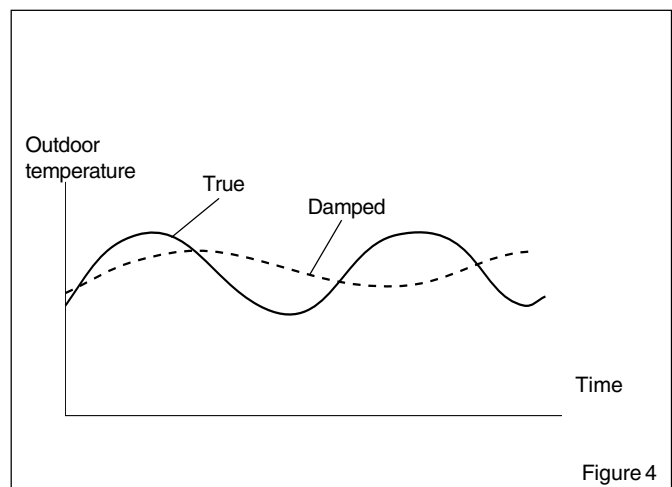


Figure 4

LIMITING THE RETURN WATER TEMPERATURE

Limitation comes into operation as soon as the return temperature exceeds the maximum permitted. The regulator then decreases the supply temperature.

The limitation is variable, i.e. it is a function of the outdoor temperature and follows a separate reset curve, with adjustable curve points: see Figure 5.

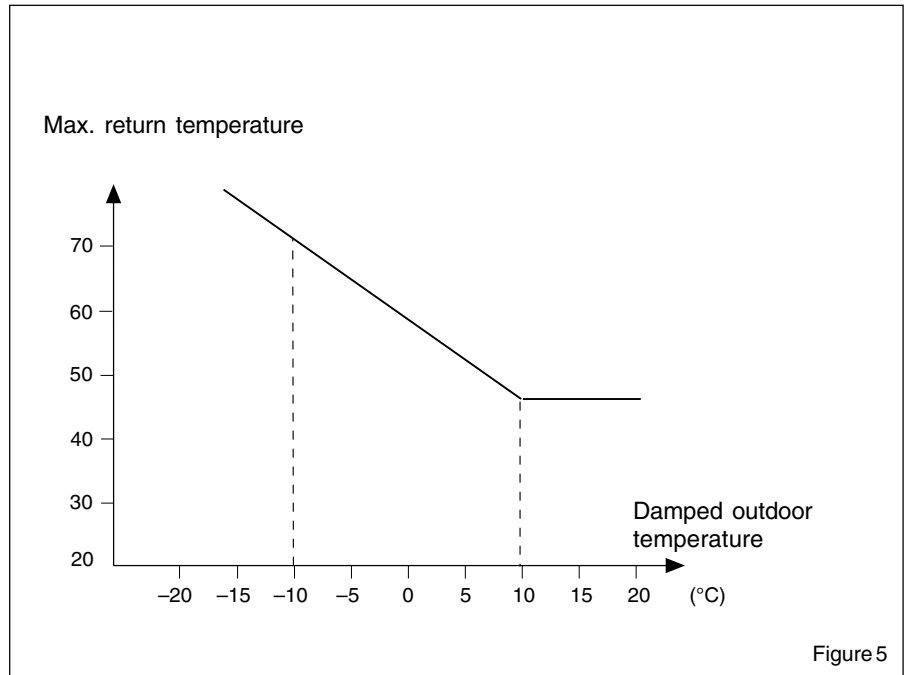


Figure 5

TIMED OPERATION

Time schedule

The controller has two weekly programs. One program controls night setbacks of heating. The other controls night setbacks of domestic hot water and any other equipment, e.g. the hot water circulation pump. In addition, up to any six holiday periods can be programmed up to a year in advance.

Optimised changeover to night setback

When the reference sensor is used, normal daytime operation is reduced according to a curve calculated by the regulator from the outdoor temperature and the control deviation in the room: see Figure 6.

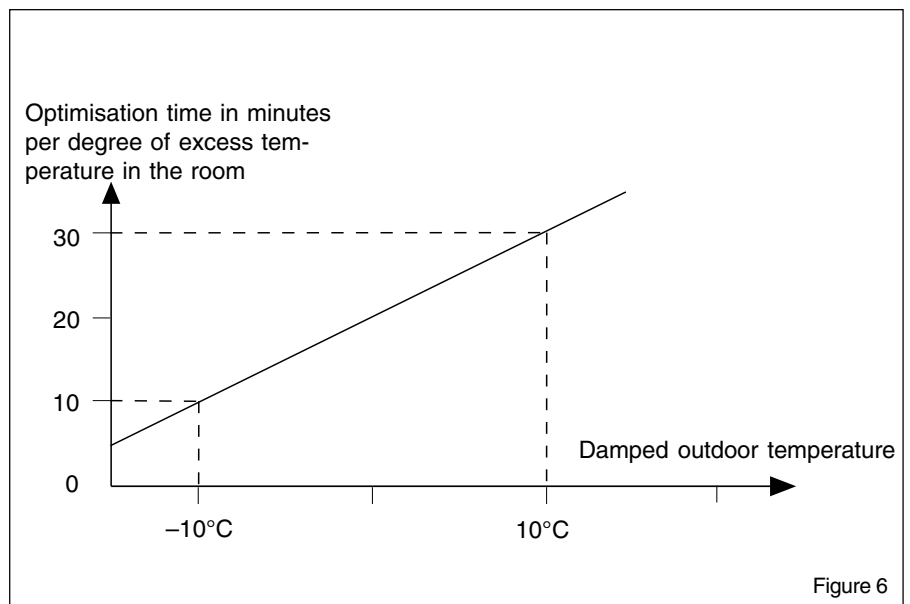


Figure 6

Variable night setback

The controller uses variable night setback to ensure that the heating system is able to restore the room temperature after night setback at low outdoor temperature.

The magnitude of the setback is a function of the damped outdoor temperature according to a curve that has two adjustable outdoor temperatures: see Figure 7.

At the point for the lowest outdoor temperature, there is no night setback at all. The latter then gradually increases as the outdoor temperature increases.

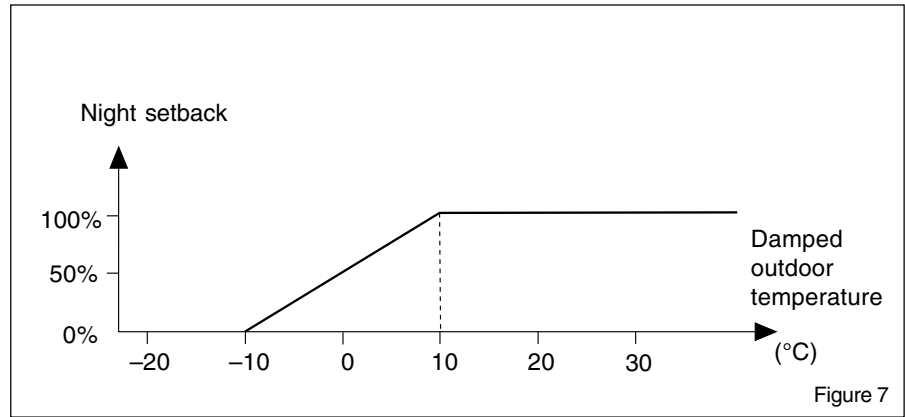


Figure 7

Morning heating

In systems with a reference sensor, the time of changeover to daytime operation is optimised automatically. This means that the controller starts the heating so that the correct temperature is obtained at the pre-set time.

The calculation is a function of a curve with self-adjusting curve points. Normal daytime operation is effected when the room temperature arrives at the level required, but not later than the pre-set time for day operation.

If there is no reference sensor, the morning heating time varies as a function of the damped outdoor temperature according to an adjustable curve: see Figure 8.

Output K2 is set during morning heating.

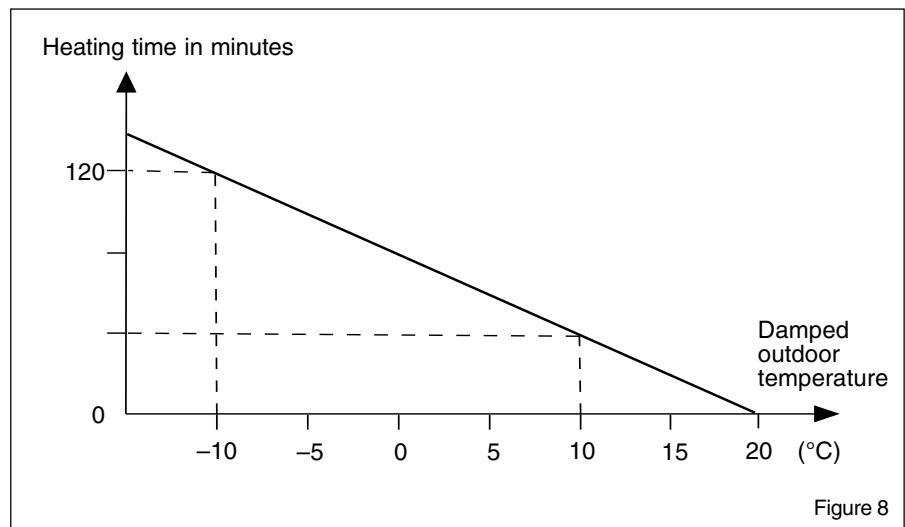


Figure 8

Morning boost

The supply temperature is boosted during morning heating. If there is no reference sensor, the boost is a function of the damped outdoor temperature: see Figure 9.

If a reference sensor is fitted, the supply setpoint is increased by a fixed value.

At 10°C the morning boost reaches its maximum value and gradually decreases until it cuts out completely at -10°C or when the outdoor temperature reaches 20°C.

Monday effect

After a weekend when night operation has lasted more than 20 hours, the controller may start the heating earlier than is usually the case for morning heating. This is done by adding a percentage value to the time in the curve for morning heating.

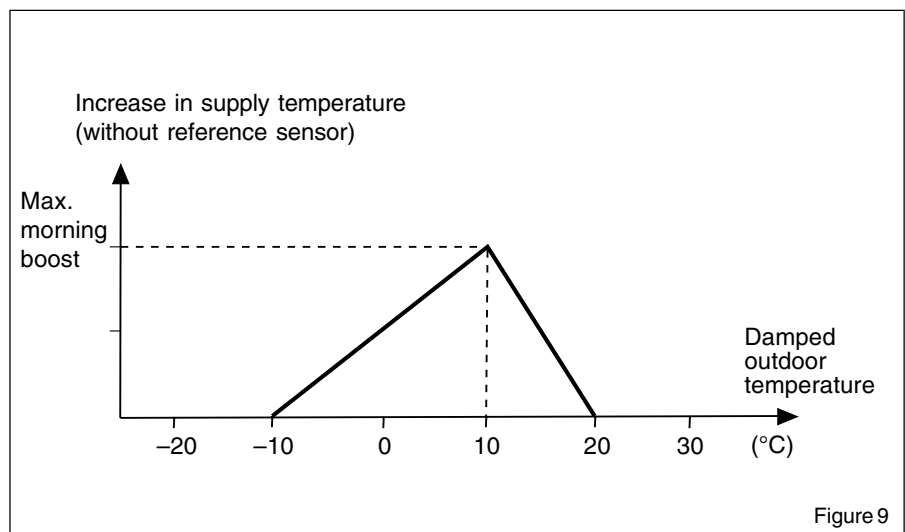


Figure 9

DOMESTIC HOT WATER

One or more control devices can be controlled. The control voltage of the output signal can be between 2 and 10 V or 0 and 10 V, and the domestic hot water can have different setpoints for day and night according to the extra weekly program.

For optimum operation, the controller should be used together with the EGWS fast temperature sensor and the M300/M750 fast actuator.

The dead zone for the domestic hot water controller is variable to ensure stability at low loads. This means that a greater dead zone is used at low loads (hot water circulation flow) and a lower value is used when the hot water starts running.

PUMP CONTROL

The logic applied to pump control is designed to use the building's accumulated heat as effectively as possible. Consequently the pump operates only when there is an actual heat demand. The following criteria apply:

- The pump is stopped and the control valve closed when the calculated supply setpoint is less than an adjustable value.
- The pump is stopped and the control valve closed when the outdoor temperature exceeds an adjustable cut-off temperature.

The time for restarting the pump after a stoppage can be set to between 0 and 12 hours.

When the criterion for stopping the pump is met, the pump is stopped after a pre-set delay of 5 minutes.

Frost protection

The frost protection function for the pump ensures that the pump always starts and the valve begins to operate when the outdoor temperature is less than +3°C with a hysteresis of 2°C.

Pump exercise function

Every Monday at 12.00, the pump starts automatically to prevent seizure.

ALARM

The following alarm functions are available:

- Pump alarm
- Deviation alarm for the supply temperature
- Deviation alarm for the domestic hot water temperature
- Output for buzzer alarm

Alarms that have been activated can be read in the regulator's display window and are reset automatically when the cause of the alarm is no longer in force.

POWER FAILURE

The controller retains all settings for an unlimited time. However, the clock must be reset manually if there is a power failure that lasts for more than 48 hours.

MAINTENANCE


The controller requires no special maintenance but should be kept clean. However, the controller equipment should be inspected regularly so that any faults do not cause overheating or freezing of the pipes.

The display window can be wiped with a moist cloth as required.

ACCESSORIES

Accessories	Part No.
Transformer TR 32	341-3032-000
Assembly kit with enclosure rating IP55	200-2993-000

INSTALLATION

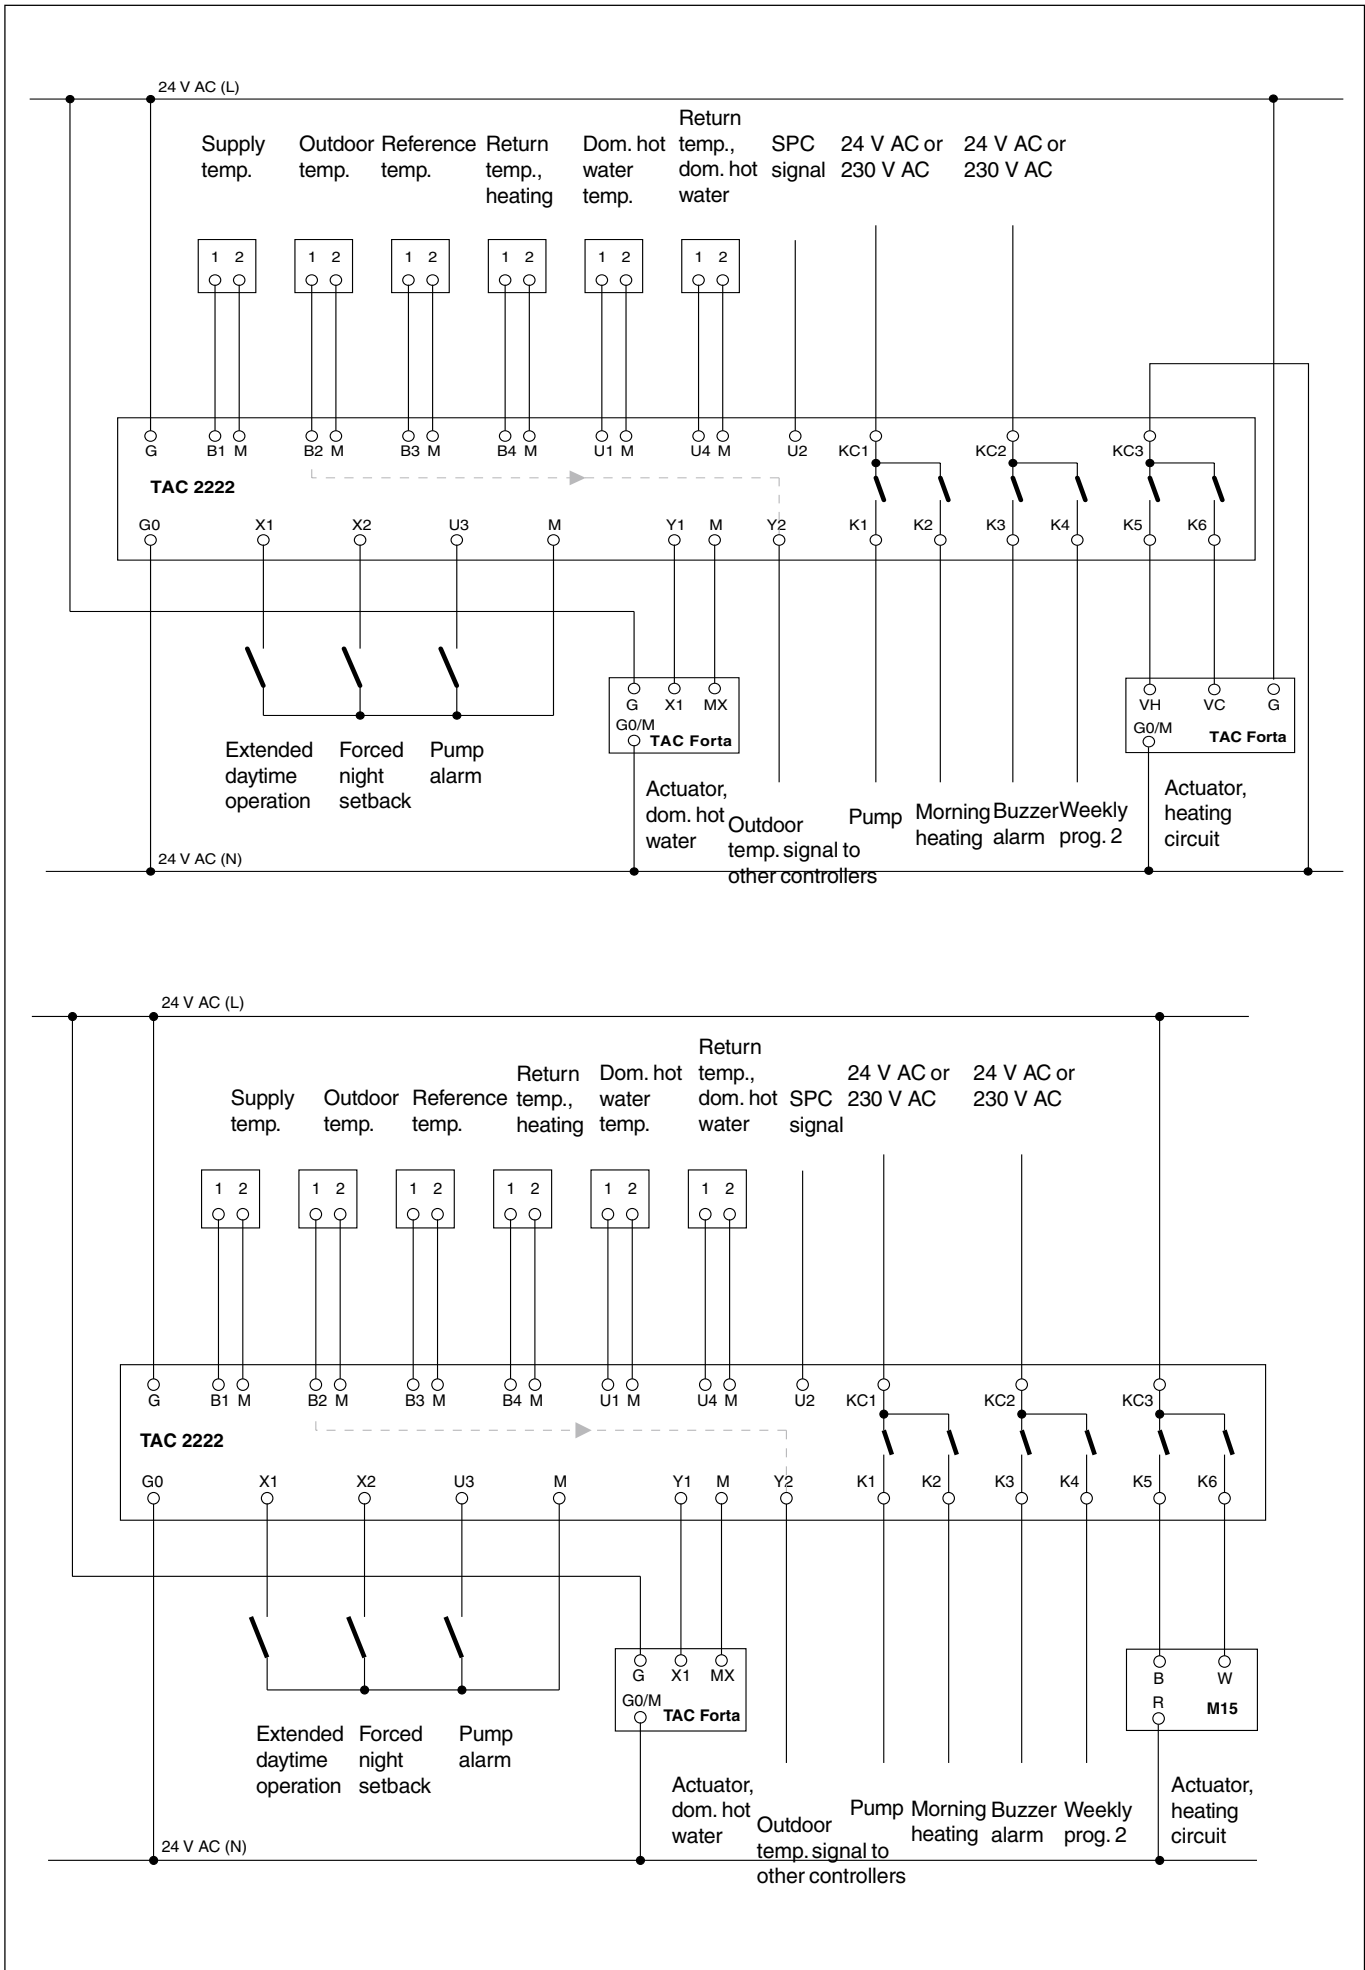

Circuit diagram

INSTALLATION

Connections at terminal block L, left side

16	Y1	Domestic hot water valve
15	Y2	Output for outdoor temp.
14	–	–
13	KC3	Common to K5 and K6
12	K5	Heating valve: increase
11	K6	Heating valve: decrease
10	–	–
9	G	Supply, 24 V AC, phase
8	G0	Supply, 24 V AC, zero
7	–	Safety ground
6	KC1	Common to K1 and K2
5	K1	Circulation pump
4	K2	Morning heating
3	KC2	Common to K3 and K4
2	K3	Output for buzzer alarm
1	K4	Output for time channel 2

Connections at terminal block R, right side

16	M	Measurement neutral
15	M	Measurement neutral
14	U1	Sensor, domestic hot water
13	U2	SPC signal
12	U3	Pump alarm
11	M	Measurement neutral
10	B1	Supply sensor
9	M	Measurement neutral
8	B2	Input for outdoor temperature
7	B3	Reference sensor
6	B4	Return sensor, heating
5	M	Measurement neutral
4	U4	Return sensor, dom. hot water
3	X1	Extended daytime operation
2	X2	Forced night setback
1	M	Measurement neutral

CABLE LENGTHS

When the 24 V transformer is placed by the TAC 2222, the following applies:

Cables to G, G0 and other terminal blocks on TAC 24 V actuators must not exceed 50 m in length, and shall have a minimum cross-sectional area of 0,8 mm². If the cables exceed 50 m in length, the minimum cross-sectional area is 1,5 mm².

Cables connected to the terminal blocks KC1, K1, K2, KC2, K3, and K4: max. 100 m in length, minimum cross-sectional area 1,5 mm².

Cables to terminal blocks types B, U, and X: max. 200 m, min. area 0,5 mm².



WARNING! Power supply cables must be connected by a suitably qualified electrician.

